


ENERGY STAR HOME BUILDER - HOUSTON

7/1/06

ALL DUCTS, SUPPLY BOXES, AND RETURN AIR BOXES LOCATED IN UNCONDITIONED SPACES SHALL BE R-6 OR GREATER.

ENERGY STAR DETAIL #3

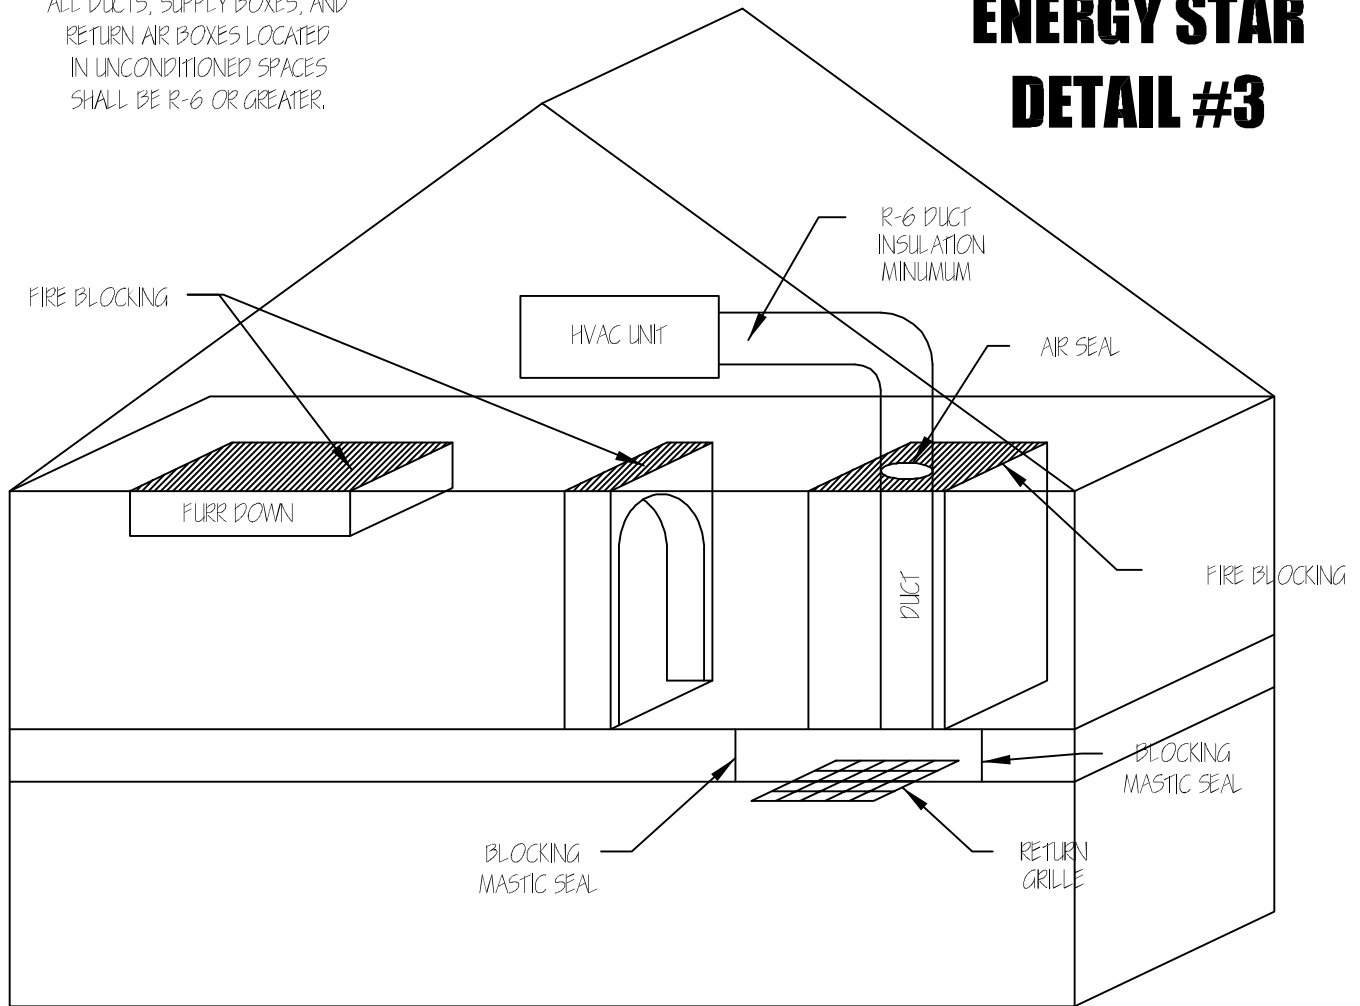

FRAMER:
SEAL CHASES WITH FIRE BLOCKING

PLUMBER:
NO GAS LINES, PLUMBING LINES,
OR VENT LINES THRU RETURN
AIR CHASES

HVAC CONTRACTOR:
CUT CLEAN HOLES IN CHASES AND SEAL
WITH APPROVED MATERIAL

USE R-6 DUCT INSULATION

ELECTRICIAN:
NO ELECTRICAL CONDUCTORS
THRU A/C CHASE

NO RETURN OR SUPPLY DUCTS
IN CHIMNEY CHASE(S)

Chase Sealing Detail



DPIS Engineering, LLC

**1600 E. Hufsmith
Tomball, TX 77375
281-351-0048 OFFICE
281-351-0148 FAX**

APPROVED _____ DATE _____
ENERGY STAR BUILDER

APPROVED _____ DATE _____
DPIS ENGINEERING

IMPLEMENTATION _____ DATE _____